





TABLICA T5

400/231V; 50Hz; $I'' < 1,73\text{kA}$
L1, L2, L3

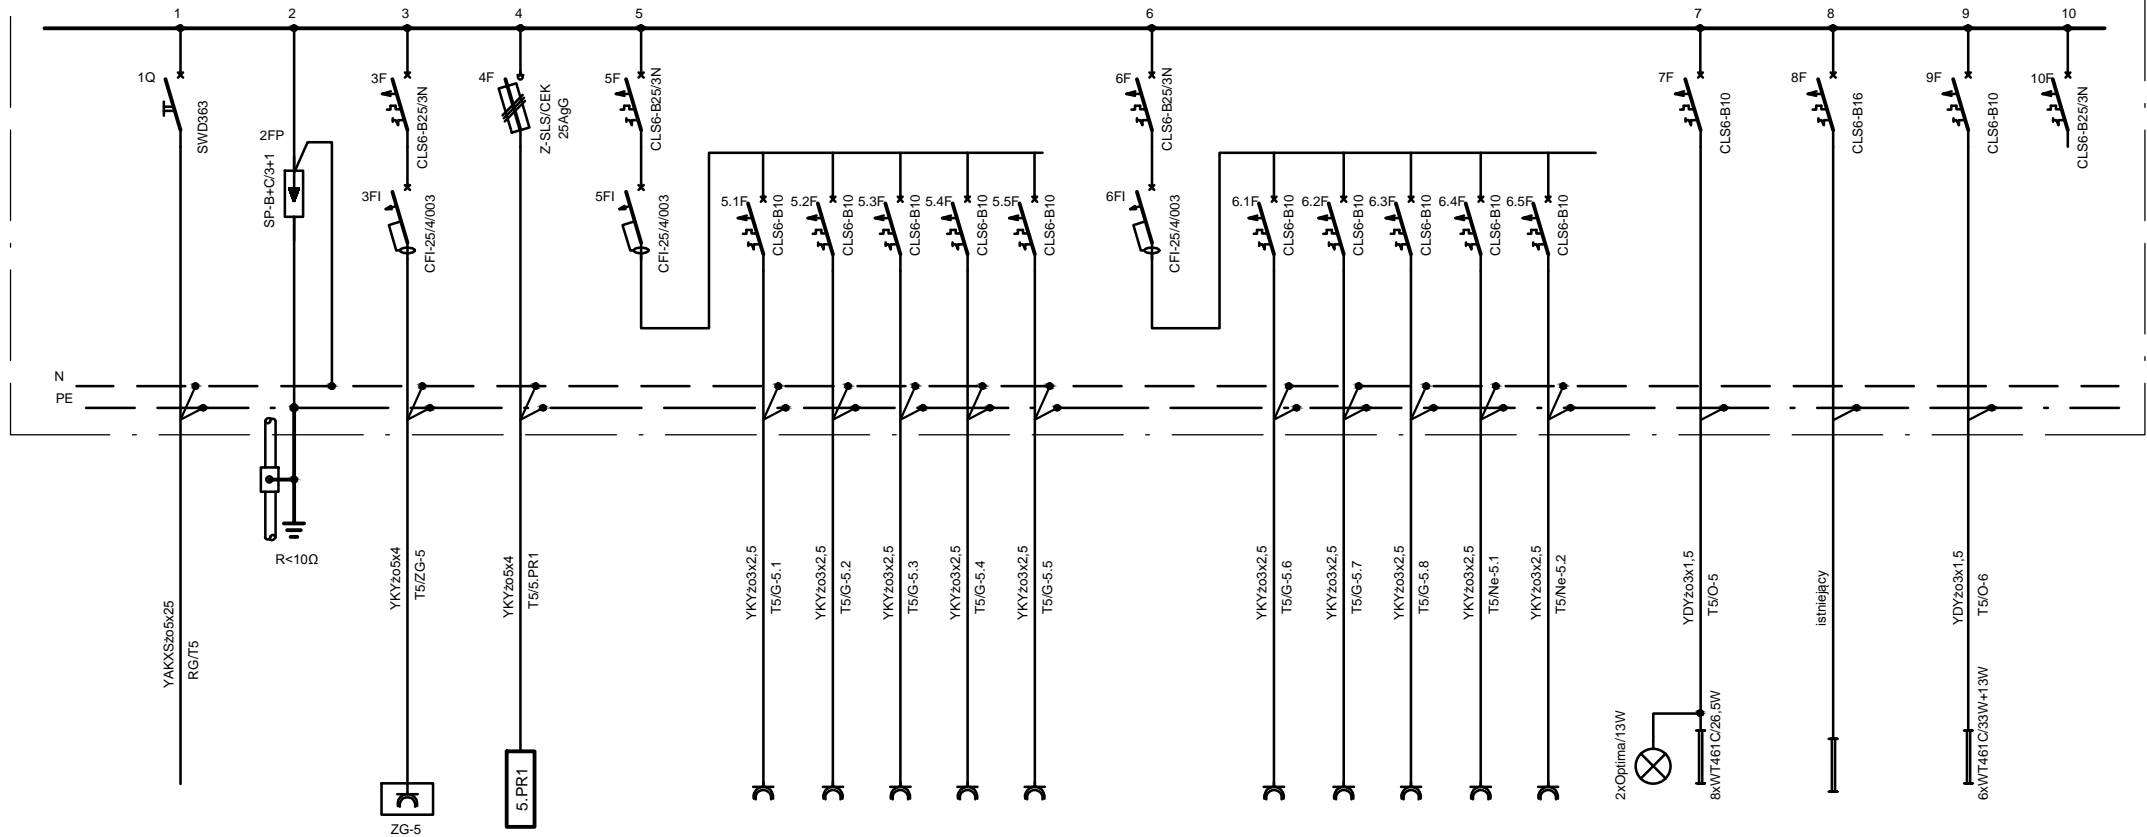

Ozn. technolog.	T5	ZG-5	5.PR1		G-5.1	G-5.2	G-5.3	G-5.4	G-5.5		G-5.6	G-5.7	G-5.8	Ne-5.1	Ne-5.2	O-5	-	O-6	
Sterowanie wg	-	-	-	-												-	-	-	
Odbiornik	Zasilanie	Zestaw gniazd	Prasa		Ogrzewanie						Ogrzewanie					Oświetlenie pomieszczenia prasy	Oświetlenie istniejących pomieszczeń	Oświetlenie magazyn osadu	rez.
Obiekt		5	5		5	5	5	5	5		5	5	5	5	5	5	5	6	
Moc Pi /Po [kW]	20/12,8	-	6,25		1,2	1,2	1,2	0,8	0,8		1,2	1,2	0,8	2	2	0,24	0,8	0,21	

	Nazwisko, imię:	Podpis	 BIURO PROJEKTOWO - BADAWCZE s.c. M. Gregorek P. Dzienis 16-020 Czarna Białostocka, Ratowice 5c	Inwestor: Gmina Kuźnica	Stadium: PW	Nr rysunku: E-09
Projektował	mgr inż. R. Nowosad			Objekt: Rozbudowa Oczyszczalni ścieków w miejscowości Kuźnica Branża elektryczna	Data: 29. 06. 2016	
Sprawdził	mgr inż. D. Nowosad			Nazwa rysunku: Tablica T5 - schemat strukturalny	Skala: %	Arkusz: 1